



FIG NO.	STOCK NO.	DESCRIPTION	MANUFACTURER	CATALOG NO.
1		4W SWITCH 2LB2FI		
2		4W SWITCH 3LB1FI		
3		4W SWITCH 4LB		
4		4W-BT SWITCH 4LB		
5		3W SWITCH 3LB		

FIGURE 1

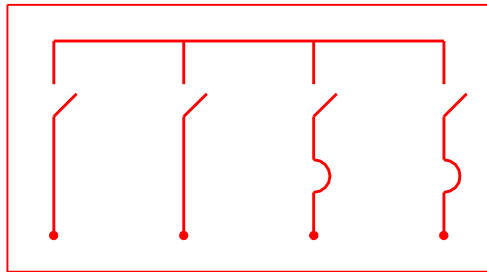


2 LOAD BREAK SWITCH 600 AMP
2 FAULT INTERRUPTER 200 AMP

FIGURE 2

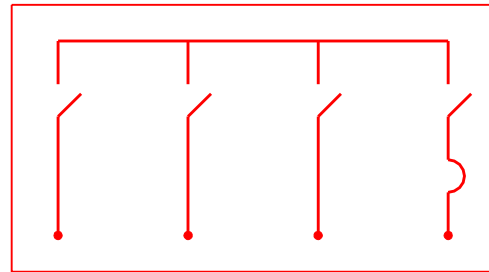


3 LOAD BREAK SWITCH 600 AMP
1 FAULT INTERRUPTER 200 AMP

FIGURE 3

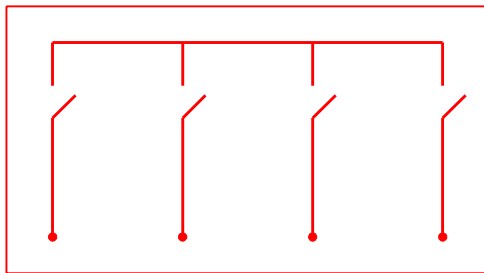


4 LOAD BREAK SWITCH 600 AMP

FIGURE 4

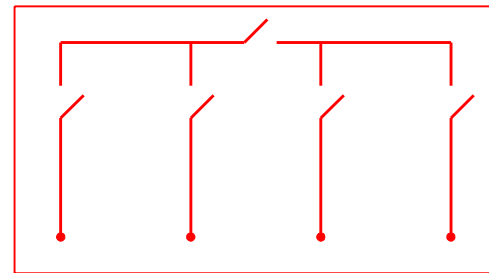

4 LOAD BREAK WITH BUS TIE SWITCH 600 AMP

FIGURE 5

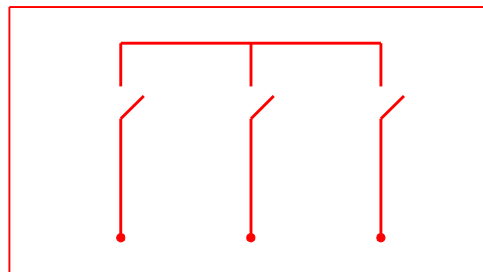

3 LOAD BREAK SWITCH 600 AMP



CITY OF LOMPOC
ELECTRIC UTILITY DIVISION

CONSTRUCTION STANDARD
ONE LINE DIAGRAM PAD MOUNTED, LOAD
BREAK SECTIONALIZING WITH OR WITHOUT
LATERAL VACUUM FAULT INTERRUPTER

29-MAR-2007	ALAN ERLAND			1	23-FEB-2009	EXHIBIT : ELE - 106
DATE DRAWN	DRAWN BY	ASSIST ELEC. UTIL. MGR.	ELEC. UTIL. MGR.	REVISION	REV. DATE	